

WINDOWS + SHUTTERS

PARKER - GRAY DISTRICT
CITY OF ALEXANDRIA



Required Approvals


There are different levels of review for buildings constructed before 1932 (Early buildings) and after 1931 (Later buildings). These levels are applicable in most cases. Please note that during the administrative review process, Staff may determine that a project requires Board review. Contact Staff at 703.746.3833 to confirm which level of review is required for your project.

Early Buildings (pre-1932)

NO REVIEW	ADMINISTRATIVE (STAFF) REVIEW	BOARD REVIEW
Routine maintenance and minor repair of windows (Type 1 and 2)	Major repair (Type 3) and replication in-kind (Type 4) of historic windows	Replacement of windows that are historically or architecturally significant
Replacement of windows that are entirely below grade or not visible from a public right-of-way	Replacement of non-historic windows	Changing window size, material, location, or operation
Removal of shutters or security bars	Changing window light configuration	Removing and infilling windows visible from a public right-of-way
	Replacement of security bars	Installation of security bars
	Installation or replacement of shutters	

Later Buildings (post-1931)

NO REVIEW	ADMINISTRATIVE (STAFF) REVIEW	BOARD REVIEW
Routine maintenance and repair of windows (Type 1, 2, and 3)	Replication in-kind (Type 4) and replacement of windows less than 15 feet from property line on street-facing sides	Replacement of windows that are historically or architecturally significant
Replacement of windows on non-street-facing sides, or 15 feet or more from property line on street-facing sides	Changing window material or light configuration	Changing window size, location, or operation less than 15 feet from property line on street-facing sides
Replacement of windows that are entirely below grade or not visible from the public right-of-way	Replacement of security bars	Removing and infilling windows visible from a public right-of-way
Removal of shutters or security bars	Installation or replacement of shutters	Installation of security bars



Introduction


Windows are a principal character-defining feature of a building and serve both functional and aesthetic purposes. The size, location, type, material, and trim of windows are a defining element of a building's style and changes to them can have a dramatic impact on the historic appearance of a structure.

In general, the windows on Federal and Georgian period buildings in Alexandria had multiple small sized panes of glass and thin muntins. Cylinder glass was used from 1840 to the early 1900s. Molten glass was blown into a cylinder, halved, and then reheated to create larger, uniform sheets of glass. It typically has small imperfections from blowing bubbles or reams (fold marks or a wave in the glass). By the middle of the 19th Century, technology permitted the manufacture of large size panes of glass with wider muntins. This enabled windows on Victorian structures to have large expanses of glass, some without muntins. Victorian period buildings dating from the mid-19th to early 20th Centuries typically have windows in a two-over-two or one-over-one configuration. Bay windows began to be used starting in the mid-19th Century as well, and can be seen on both Victorian and Colonial Revival buildings. Colonial Revival buildings generally have multi-light windows with small panes of glass, often with a single light below.

The mid- to late 20th Century saw an increase in the use of commercially available non-wood window materials:

- o Wood composite windows became available in the 1960s; they use a material that is made of polymers and wood fibers.
- o Aluminum-clad windows became available in the 1970s; they combine a wood interior with an aluminum exterior.
- o Fiberglass windows became available in the 1980s; they use a composite material that is made of polymers and extruded glass fibers.

Like windows, shutters are an important visual detail of the overall composition of a building and serve both functional and decorative purposes. Historically, shutters were an important means of regulating temperature and ventilation and protecting the interior of a structure during severe weather. Shutters serve as a means of clearly defining the openings in a building facade. Inappropriate shutters detract from the design integrity of a building and create a false impression of the architectural character of a structure.



Glossary

Muntin: A strip of metal or wood separating panes of glass within a window sash.

Mullion: A vertical shaft between two window panes that provides structural support.

Sash Kit Replacement: Replacement of the window sash panel(s) without removing the existing frame.

Insert (Pocket-Style) Replacement: Installation of a new window sash and frame into the existing frame, usually resulting in less glass area and wider trim.

Single Glazing: A single pane of thick glass.

Double Glazing: Two panes of glass separated by a layer of gas.

True Divided Light (TDL): Multiple panes of glass separated by muntin bars.

Simulated Divided Light (SDL): Permanently fixed muntins on both the interior and exterior of the glass, with spacer bars between the glass.



Grilles Between Glass (GBG): Single grille sandwiched between two panes of glass; also known as “sandwich muntins”.

Visible Light Transmission (VLT): The amount of light that passes through window glass.


Low Emissivity (Low-E) Glass: Has a coating that minimizes the amount of ultraviolet light that can pass through the window glass without compromising the amount of visible light transmitted.

Shading Coefficient: The ratio of solar heat gain passing through window glass in comparison to a standard piece of 1/8-inch thick clear glass.

Storm Window: Window mounted outside or inside of the main glass windows, providing more insulation and reducing air movement into and out of the windows.

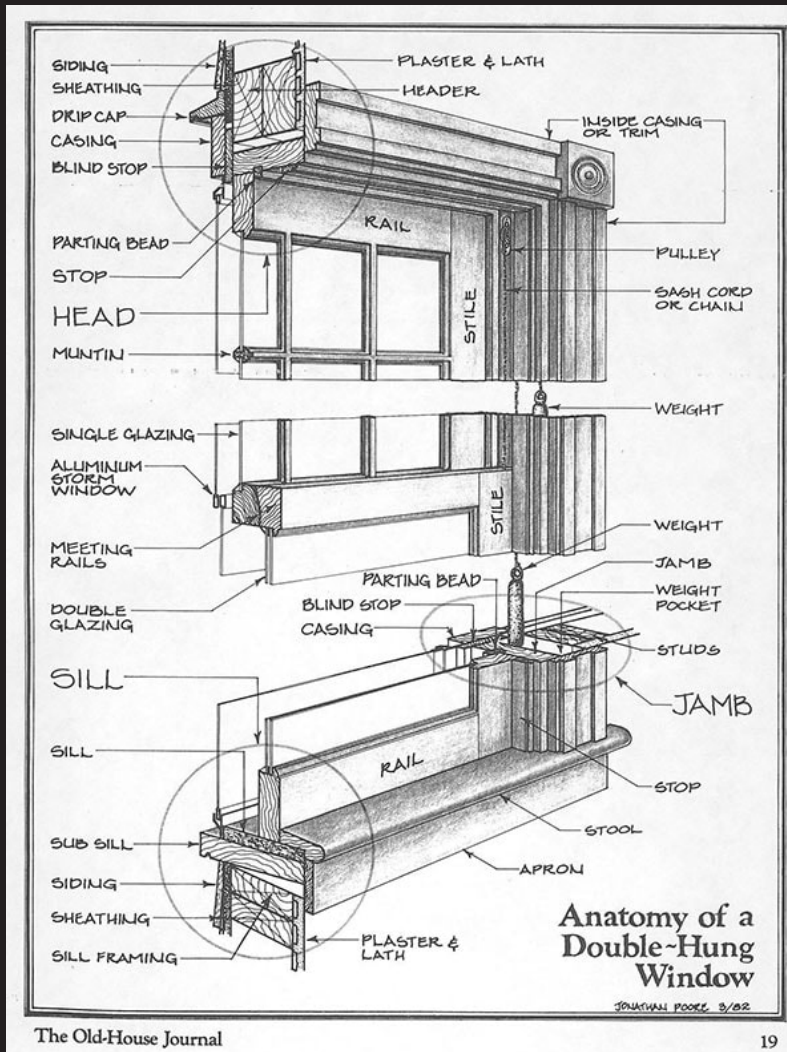

This diagram shows the parts of a typical historic window as viewed from the inside.



Window Maintenance, Repair, and Replacement

Historic windows require regular maintenance in order to maintain their functionality and structural integrity. The Board encourages the retention and repair of historic windows whenever possible. This section gives an overview of four types of window conditions and what types of repairs they entail. These range from Type 1, which includes various types of routine maintenance, to Type 4, in which the condition of the window is deteriorated to the point that a replication in-kind may be appropriate.

Type 1: Routine Maintenance

- o Replacement of glazing putty
- o Minimal replacement of broken window panes
- o Repainting and/or removal of loose paint
- o Repair or replacement of window sash weights/chords
- o Installation of weatherstripping
- o Installation or replacement of storm window


Type 2: Minor Repairs

- o May require removal of sashes to perform repairs
- o Repair or fill of sections of window sash or frame material
- o Repair of sections of muntins
- o Repair of exterior window trim
- o Replacement or installation of up to 50% of window panes

Image coming soon

Image coming soon

WINDOWS + SHUTTERS



Type 3: Major Repairs and Partial Replacement

- o May require removal of sill and frame to perform repairs
- o Replacement of sections of window sash or frame material in-kind
- o Replacement or installation of more than 50% of window panes
- o Reframing or reconstruction of existing window opening


Type 4: Beyond Repair

- o May require a replication of the window in-kind (material, profile, and size of rail, stile, and glazing type)

Image coming soon

Image coming soon

Staff will evaluate windows in the field using these conditions to determine what type of repair work is most appropriate. Major repairs, replication, or replacement of windows that are visible from a public right-of-way generally require BAR review, while routine maintenance and minor repairs do not require BAR review. Where Staff makes a written finding that a window is not visible from a public right-of-way, the window is not regulated by the BAR and may be replaced with any suitable window allowed by the [Virginia Unified Statewide Building Code \(USBC\)](#).




Window Guidelines

There are different guidelines for buildings constructed before 1932 (Early buildings) and after 1931 (Later buildings). When an administrative review is requested, window manufacturer technical specification sheets, or “cut sheets”, must be submitted to BAR Staff to confirm compliance with these guidelines. If Staff is unable to verify that a window complies with the guidelines, the Board will review the request.

All Buildings

- o Window frames, sashes, and glass should be repaired rather than replaced, when possible.
- o Character-defining features of windows should not be altered.
- o Replacement window materials, operation, and configuration should be appropriate to the architectural style and/or period of significance of the building.
- o Replacement windows should fit the original window opening; full frame replacement or unframed sash replacement kits are acceptable. Insert windows are not appropriate.
- o Low-E glass is encouraged for energy conservation, but the glass must have a minimum 72% VLT with a shading coefficient between 0.87 – 1.0 and a reflectance of less than 10%. Low-E 272 glass meets these requirements.
- o Windows should not be painted, inappropriately tinted, or otherwise made opaque.
- o The exterior of sash muntins must have a putty-glazed profile; the interior of sash muntins may have any profile.
- o Multi-light windows should be either Simulated Divided Light or True Divided Light; Grilles Between the Glass are not appropriate.
- o Spacer bars should be dark in color.
- o Vinyl windows are not appropriate.
- o The Board discourages cladding or capsulating existing wood jambs, sills, or trim.
- o The vinyl weatherstrip portion of wood window jambs should be minimally visible.
- o Security bars should be minimally visible and architecturally appropriate.






Early Buildings (pre-1932)


- o Historic windows on Early buildings should be repaired rather than replaced (Type 1, 2, and 3). Replication in-kind (Type 4) is encouraged where the windows are historically or architecturally significant.
- o If Staff or the Board determines that a window can be replaced, every effort should be made to maintain the design consistency of the facade. For example, if one window needs to be replaced, it should replicate the remaining windows.
- o When restoring the appearance of historic cylinder glass in original window sash, only restoration glass with the minimum amount of visual distortion should be used. Restoration glass should not be used on new windows.
- o The exterior architectural style, dimensions, and proportions of window rails, stiles, muntins, frame, sill, and exterior trim must match historically appropriate window appearance. Exterior trim may not be mitered at the corners.
- o On street-facing sides, windows should be made of wood. Multi-light windows should be single glazed; double glazing may be used for windows that are in a one-over-one or two-over-two configuration.
- o On non-street facing sides, windows may be made of modern materials such as wood composite, aluminum clad wood, or fiberglass, but not hollow vinyl or vinyl cladding. Double glazing may be used for any configuration.

Later Buildings (post-1931)

- o Windows on Later buildings can generally be replaced, but historically or architecturally significant windows should be repaired or replicated in-kind.
- o On street-facing sides, windows less than 15 feet from the property line may use modern materials such as wood composite, aluminum clad wood, and fiberglass, but not hollow vinyl or vinyl cladding. Windows 15 feet or more from the property line may be any material, operation or configuration.
- o On non-street-facing sides, windows may be any material, operation or configuration.
- o Double glazing may be used on any elevation.
- o Single horizontal metal muntin and metal casement windows may be appropriate for buildings dating from the late 1940s or early 1950s.
- o Fiberglass windows may generally replace steel sash windows on any building when using the same light configuration, color, and operation, except where Staff believes an architecturally significant building has existing intact and restorable steel sash.


WINDOWS + SHUTTERS

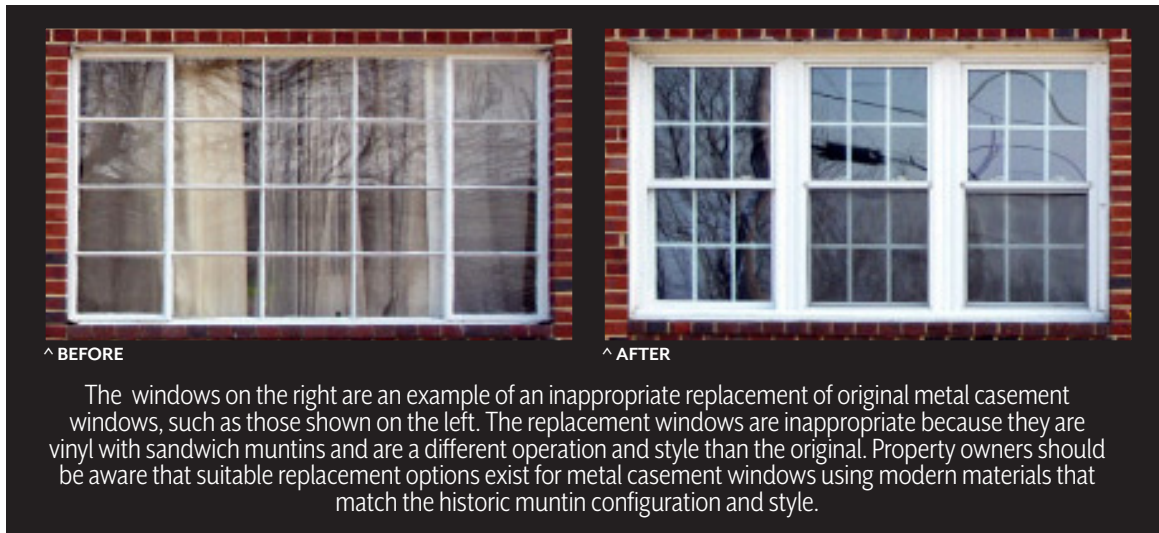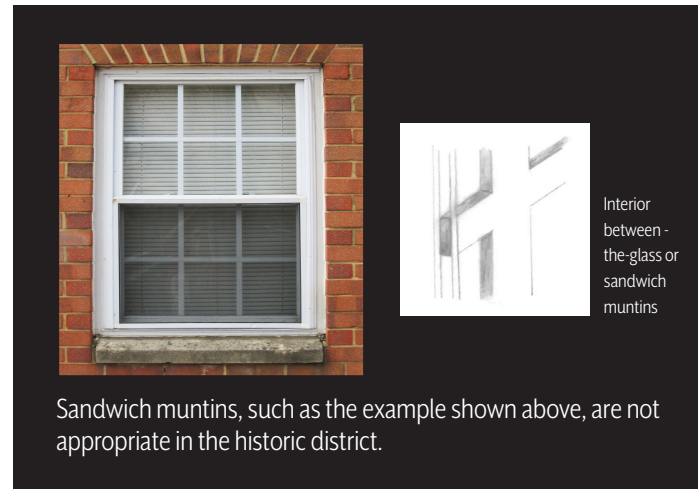



Shutter Guidelines


- o Historic shutter hardware should be retained rather than removed or replaced.
- o Shutters should be operable and appropriately sized to fit the window opening when closed.
- o Shutters may be made of wood or a solid, paintable composite material, but not hollow vinyl or aluminum.

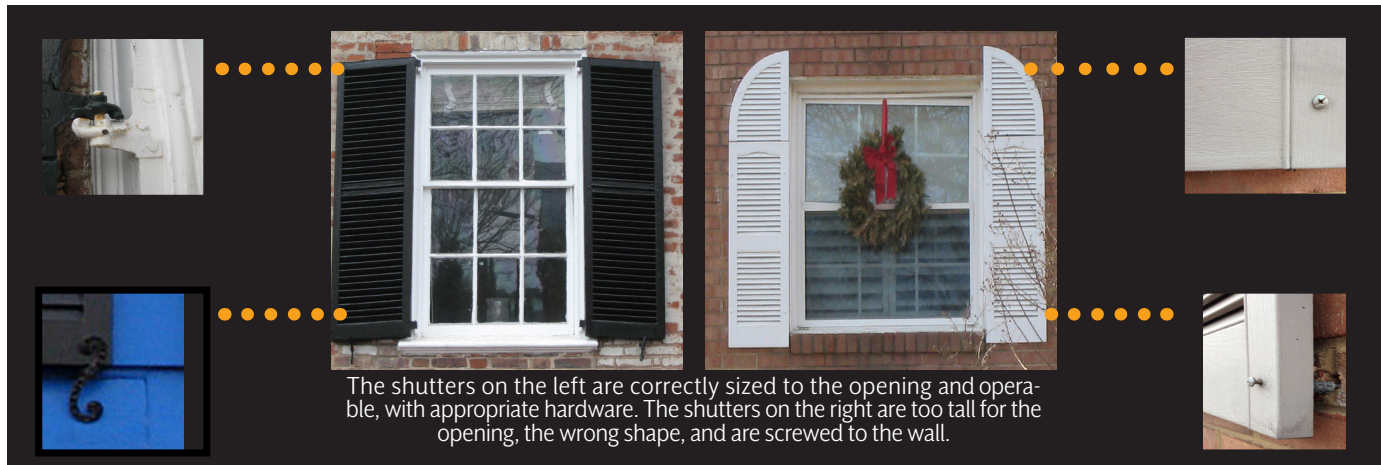

The shutters on the left are correctly sized to the opening and operable, with appropriate hardware. The shutters on the right are too tall for the opening, the wrong shape, and are screwed to the wall.

Additional Information

- o For guidelines on dormer windows, refer to chapter on dormers.
- o A building permit is required from Code Administration for all window replacements in the historic district, except for sash kits, pursuant to § 15.2-2306 of the Code of Virginia.
- o The capsulation or removal of over 25 square feet of window or wall area requires a Permit to Demolish.
- o Bay windows are permitted to project 20 inches or less into a required yard; refer to [§ 7-202](#) of the Zoning Ordinance.
- o Windows that project into the public right-of-way may require an encroachment permit from Transportation & Environmental Services.
- o Windows that are used to satisfy emergency egress requirements must meet the requirements of the [Virginia Uniform Statewide Building Code \(USBC\)](#).
- o Sash replacement kits help preserve historic frames and trim.
- o Regular painting and weather stripping of windows helps ensure longevity and promote environmental sustainability.



Storm Windows

Storm windows provide a cost-effective and thermally efficient means of energy conservation. They reduce exterior noise and reduce maintenance of historic windows. They can be installed on the exterior or interior. Because they protect historic windows, they are not regulated by the BAR and do not require review, as long as the glass is clear and non-reflective. The Board recommends that the color of the storm window frame match the color of the main window frame.

Additional Resources

[National Park Service Preservation Brief #9: The Repair of Historic Wooden Windows](#)

[National Park Service Preservation Brief #13: The Repair and Thermal Upgrading of Historic Steel Windows](#)

[Window Preservation Alliance](#)

[Window Types and Technologies \(U.S. Department of Energy\)](#)

[Window Glossary \(Window & Door Manufacturers Association\)](#)

[Saving Windows, Saving Money: Evaluating the Energy Performance of Window Retrofit and Replacement \(National Trust for Historic Preservation Green Lab\)](#)

[A Comparative Study of the Cumulative Energy Use of Historical Versus Contemporary Windows](#)



WINDOWS + SHUTTERS

PARKER - GRAY DISTRICT
CITY OF ALEXANDRIA



WINDOW CONFIGURATIONS FOUND THROUGHOUT THE DISTRICT



^ 12/12 GEORGIAN



^ 9/9 GEORGIAN



^ 6/6 FEDERAL / GREEK REVIVAL



^ 6/9 GREEK REVIVAL



^ 4/4 LATE GREEK / EARLY VICTORIAN



^ 2/2 VICTORIAN



^ 1/1 VICTORIAN




^ GOTHIC REVIVAL



^ COLONIAL REVIVAL / CRAFTSMAN

WINDOWS + SHUTTERS

PARKER - GRAY DISTRICT
CITY OF ALEXANDRIA



ARCHITECTURALLY SIGNIFICANT WINDOWS FOUND THROUGHOUT THE DISTRICT



^ GOTHIC REVIVAL



^ BOX BAY



^ ORIEL



^ PALLADIAN / VENETIAN



^ BOW




^ LANCET TRACERY



^ ROUND / ELLIPTICAL



^ LUNETTE

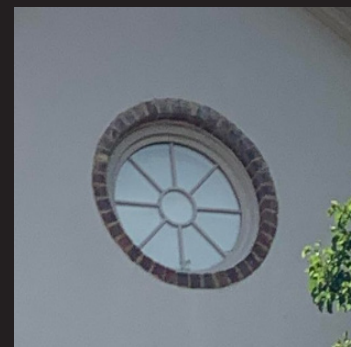

^ OCULUS / BULLSEYE